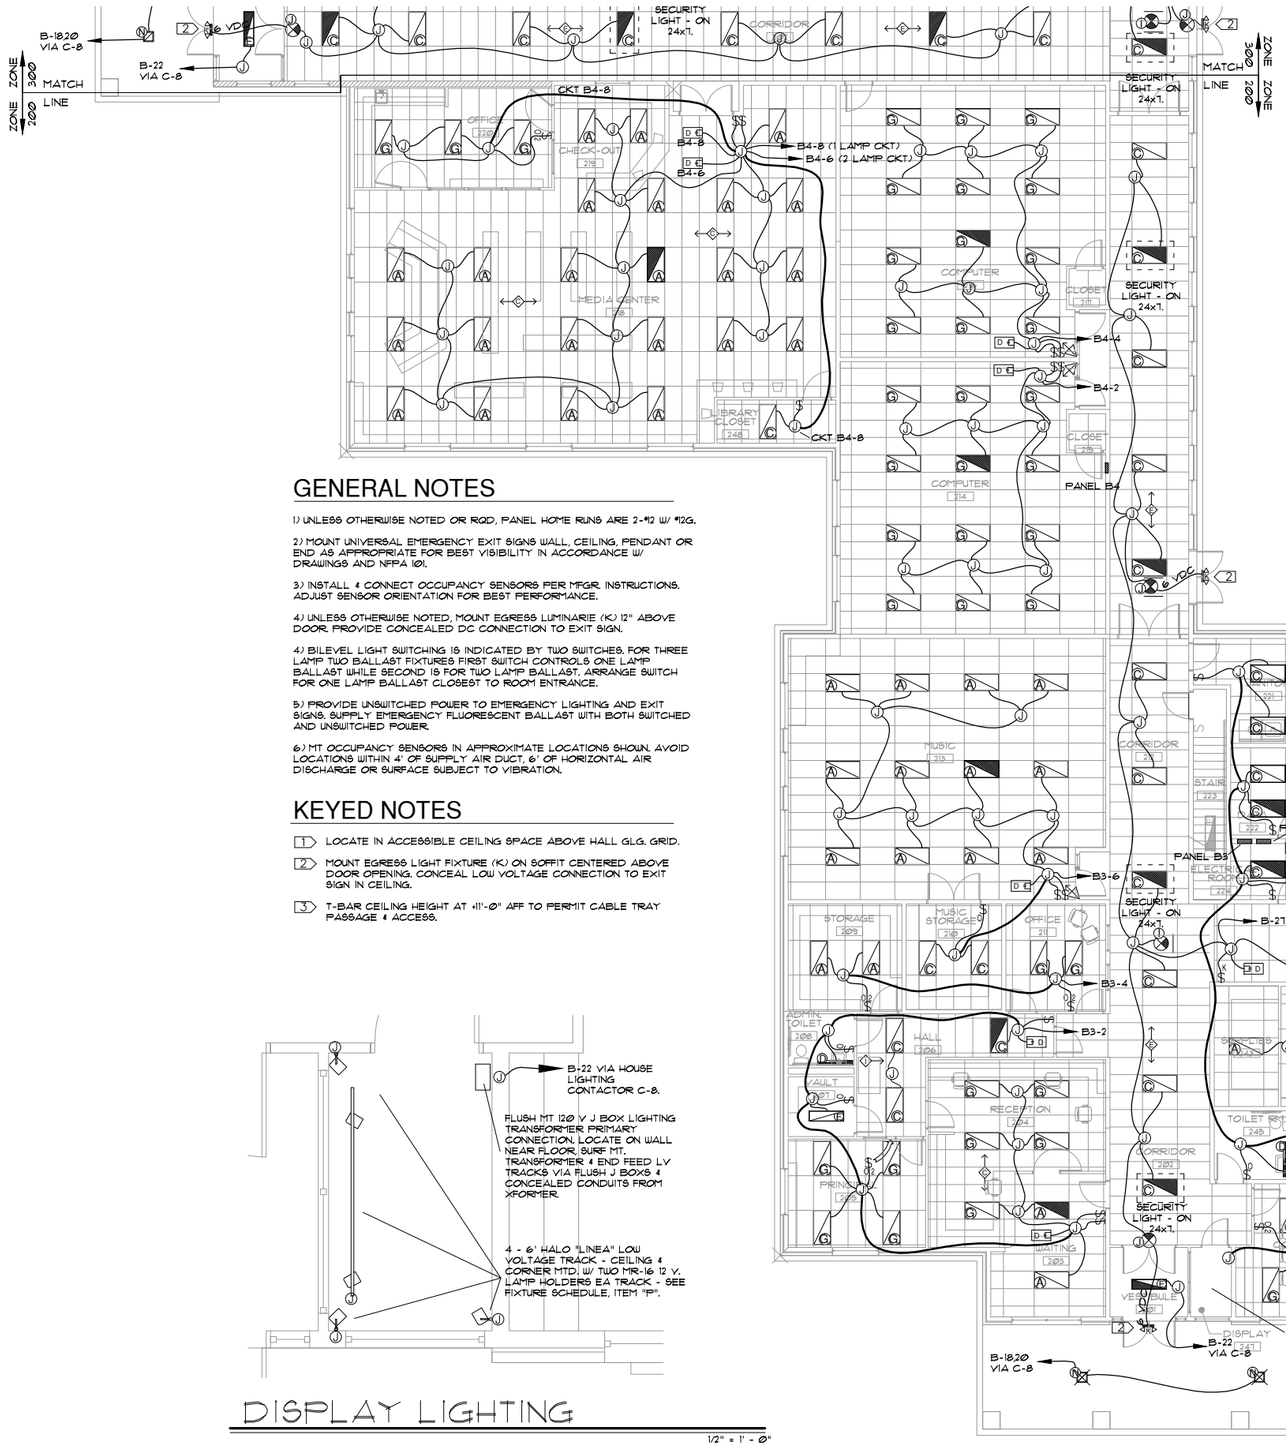

GENERAL NOTES

1) UNLESS OTHERWISE NOTED OR REQD, PANEL HOME RUNS ARE 2-#12 W/ #12G.

2) MOUNT UNIVERSAL EMERGENCY EXIT SIGNS WALL, CEILING, PENDANT OR END AS APPROPRIATE FOR BEST VISIBILITY IN ACCORDANCE W/ DRAWINGS AND NFPA 101.

3) INSTALL & CONNECT OCCUPANCY SENSORS PER MFGR. INSTRUCTIONS. ADJUST SENSOR ORIENTATION FOR BEST PERFORMANCE.

4) UNLESS OTHERWISE NOTED, MOUNT EGRESS LUMINARIE (K) 12" ABOVE DOOR. PROVIDE CONCEALED DC CONNECTION TO EXIT SIGN.

5) BILEVEL LIGHT SWITCHING IS INDICATED BY TWO SWITCHES. FOR THREE LAMP TWO BALLAST FIXTURES FIRST SWITCH CONTROLS ONE LAMP BALLAST WHILE SECOND IS FOR TWO LAMP BALLAST. ARRANGE SWITCH FOR ONE LAMP BALLAST CLOSEST TO ROOM ENTRANCE.

5) PROVIDE UNSWITCHED POWER TO EMERGENCY LIGHTING AND EXIT SIGNS. SUPPLY EMERGENCY FLUORESCENT BALLAST WITH BOTH SWITCHED AND UNSWITCHED POWER.

6) MT OCCUPANCY SENSORS IN APPROXIMATE LOCATIONS SHOWN. AVOID LOCATIONS WITHIN 4' OF SUPPLY AIR DUCT, 6' OF HORIZONTAL AIR DISCHARGE OR SURFACE SUBJECT TO VIBRATION.

KEYED NOTES

1. LOCATE IN ACCESSIBLE CEILING SPACE ABOVE HALL GLG. GRID.
2. MOUNT EGRESS LIGHT FIXTURE (K) ON SOFFIT CENTERED ABOVE DOOR OPENING. CONCEAL LOW VOLTAGE CONNECTION TO EXIT SIGN IN CEILING.
3. T-BAR CEILING HEIGHT AT +11'-0" AFF TO PERMIT CABLE TRAY PASSAGE & ACCESS.

DISPLAY LIGHTING

1/2" = 1' - 0"

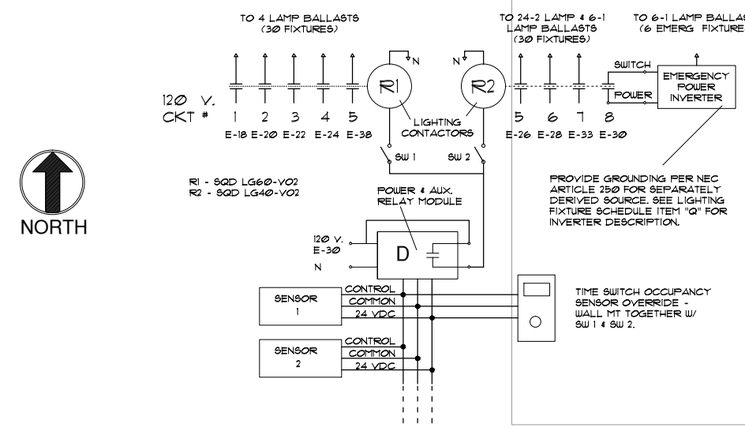

GYM LIGHTING CONTROL

NTS

NORTH

LIGHTING PLAN ZONE 200

SCALE: 1/8" = 1'-0"

PROFESSIONAL ENGINEER REGISTERED 9263 STATE OF IDAHO JACK TERRY

DATE SEALED: 12/12/05

REVISIONS 02/07/06

DATE ◇ 09-19-05
DRAWN BY ◇ J.S.
CHECKED BY ◇ JACK TERRY
ECLLC. NO. ◇ 0515
ARCH. NO. ◇ 04029

EDWARDS & CUMMINGS, L.L.C.
CONSULTING ENGINEERS
156 S.E. FIRST AVE., SUITE 1
ONTARIO, ORE. 97914
541/889-5411 FAX: 541/889-2074
E-MAIL: jack@jackterry.net

CASTELLAW ◆ KOM ◆ ARCHITECTS
850 MAIN STREET ◆ LEWISTON, IDAHO
OFFICE (208) 746-0183 ◆ FAX (208) 746-7287

PROJECT ◇ FRUITLAND SCHOOL DISTRICT #373
FRUITLAND, IDAHO

DRAWING ◇ LIGHTING PLAN ZONE 200

BUILDING ◇ ELEM

SHEET ◇ E2.1